


Members of Pritchett Water Supply Corporation
Notification of Maintenance/Repairs on Plant #20

Beginning today, May 16, 2022, Pritchett Water Supply will bypass the elevated storage tank @ Plant #20, 3670 State Hwy 155 S, Gilmer, Texas, also known as the office location to do repairs to the elevated storage tank.

You will not be without water as water from other Plants and Wells will be redirected at this time. However, you may experience a variance of pressure and possible discolored water. The water has been disinfected and safe for use but due to pressure changes, minerals that discolor the water may be observed. Estimated time of repairs is 3 weeks, so please be patient as these repair issues must be addressed and completed. Please contact the office @ 903-734-5438 if you experience any issues to help us pinpoint problem areas, and please be conservative with water usage as much as possible. We apologize for any inconveniences during this time of repairs. We have highlighted areas on the map for you to see if your water maybe affected.

Areas that maybe affected...

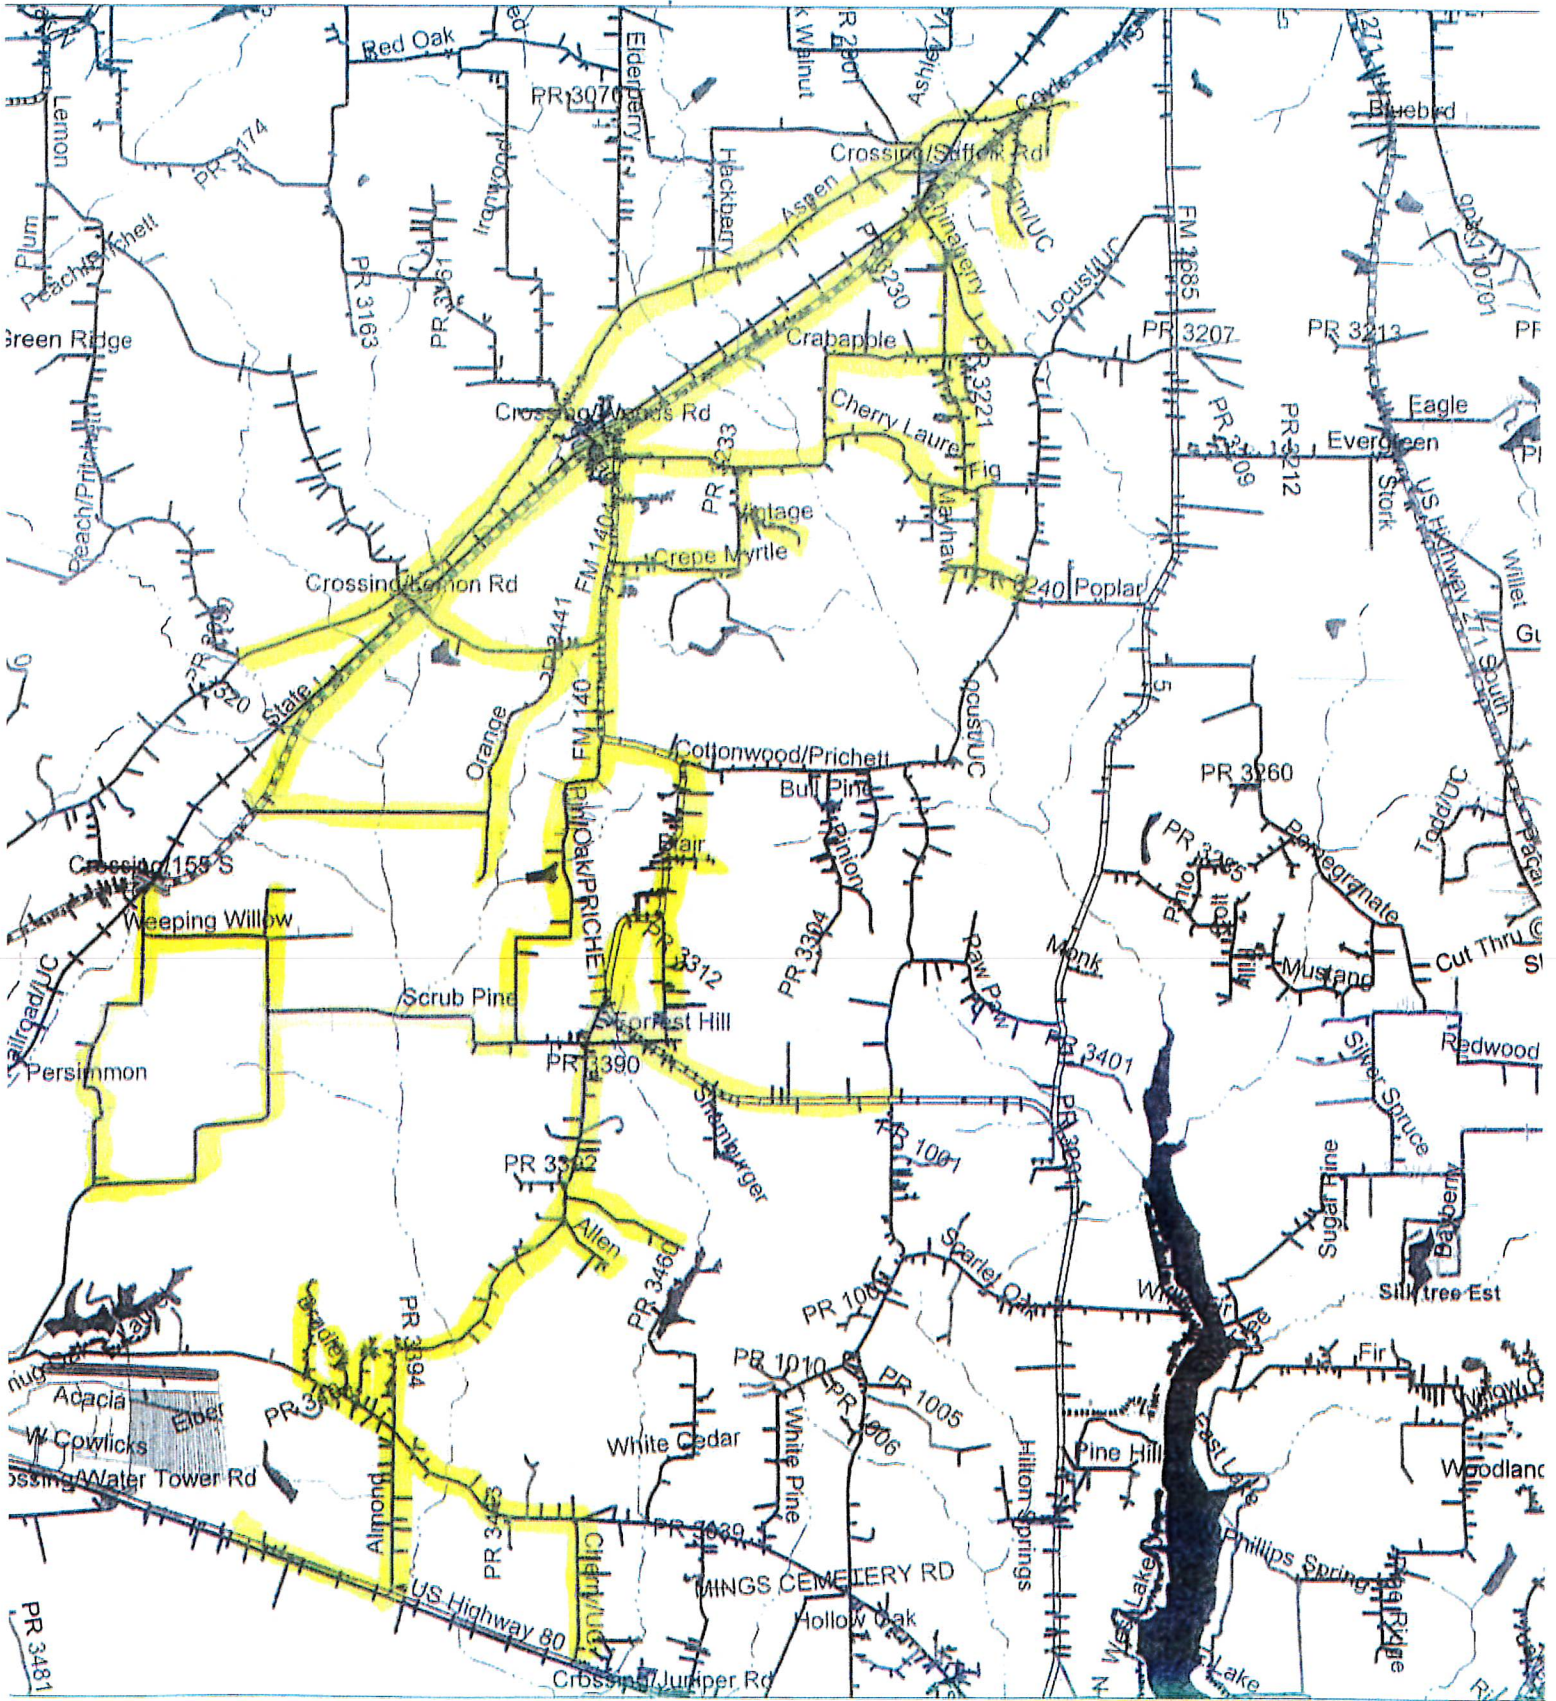

Hwy 155 S to Mulberry, Chinaberry, Balsam, Elm, Blackhaw, Coyle, Crabapple, Cherry Laurel, Coconut, Mayhaw, Fig, Holly to Ironwood, Aspen to Red Cedar, Cage, Granada, Crepe Myrtle, Holloway, Vintage, Sequoia, Lemon, Orange, Mulberry, Elm Hill, Caleb, Blair, Pin Oak, Shag Bark, Scrub Pine, Weeping Willow, Persimmon, Almond, parts of Locust, White Oak from Cherry to Bradley; parts of Hwy 80